




BRANZ Appraised
Appraisal No. 822 [2013]

SOLITEX EXTASANA WALL PROTECTION MEMBRANE

Appraisal No. 822 [2013]

Amended 06 May 2014

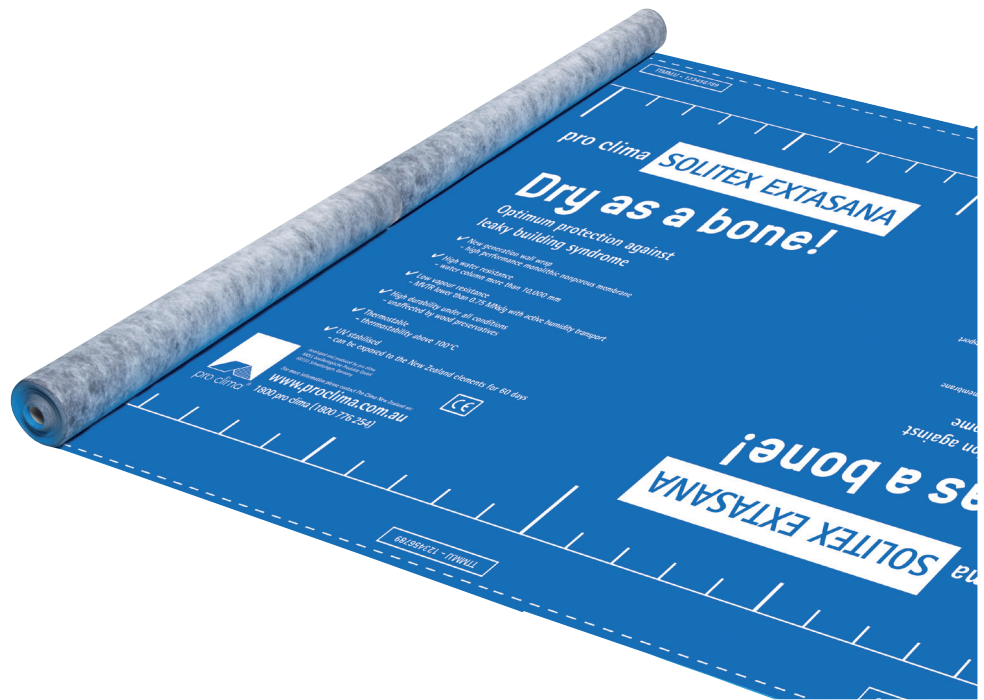

BRANZ Appraisals

Technical Assessments of products
for building and construction.



Pro Clima Australia Pty Ltd

PO Box 924
Gosford
NSW 2250
Australia
Tel: 1 800 776 254

Web: www.proclima.com.au

E-mail: welcome@proclima.com.au



BRANZ

BRANZ

1222 Moonshine Rd,
RD1, Porirua 5381
Private Bag 50 908
Porirua 5240,
New Zealand
Tel: 04 237 1170
branz.co.nz



Product

- 1.1 SOLITEX EXTASANA is a fire retardant, synthetic wall sarking for use under masonry veneer and other direct fixed and cavity-based wall claddings on timber and steel framed buildings. The product consists of a non-porous water resistant film laminated between two layers of non woven spun-bonded polypropylene, and is coloured blue on the top surface and grey on the bottom surface.

Scope

- 2.1 SOLITEX EXTASANA has been appraised for use as a wall sarking on buildings within the following scope:
 - Class 1 and Class 10 buildings; and,
 - Class 2 to Class 9 buildings subject to specific weathertightness design; and,
 - constructed with timber framing in accordance with the BCA, or steel framing in accordance with the BCA; and,
 - with absorbent wall claddings directly fixed to framing; and,
 - with non-metallic, non-absorbent wall claddings directly fixed to framing; and,
 - with absorbent and non-absorbent wall claddings installed over an 18 mm minimum drained cavity; and,
 - with masonry veneer in accordance with the BCA; and,
 - situated in non-cyclonic wind zones up to, and including N3.
- 2.2 Building designers are responsible for the building design and for the incorporation of SOLITEX EXTASANA into their design in accordance with the declared properties and the instructions of Pro Clima Australia Pty Ltd.

Building Regulations

National Construction Code Series (NCC) Building Code of Australia (BCA)

- 3.1 In the opinion of BRANZ, SOLITEX EXTASANA, if used, designed, installed and maintained in accordance with the statements and conditions of this Appraisal, will contribute to meeting the following provisions of the BCA:

BCA Volume 1 - Class 2 to Class 9 Buildings

Part F1 - DAMP AND WEATHERPROOFING: Performance Requirement FP1.4. SOLITEX EXTASANA will contribute to meeting this requirement. See Paragraphs 13.1 and 13.2.

BCA Volume 2 - Class 1 and Class 10 Buildings

Part 2.2 DAMP AND WEATHERPROOFING: Performance Requirement P2.2.2. SOLITEX EXTASANA will contribute to meeting this requirement. See Paragraphs 13.1 and 13.2.

- 3.2 This is an Appraisal of an **Alternative Solution** in terms of Building Code of Australia compliance.

Technical Specification

- 4.1 SOLITEX EXTASANA is a synthetic sarking for use under wall claddings. The product consists of a water resistant film laminated between two layers of non woven spun-bonded polypropylene. SOLITEX EXTASANA is coloured blue on the top face and grey on the bottom face.
- 4.2 The product is supplied in rolls 1.5 m wide x 36.5 m long and 2.74 m wide by 36.5 m long. The product is printed with the SOLITEX EXTASANA logo and other product information (including batch number) repeated along the length of the roll. The rolls are wrapped in clear polythene film.

Accessories

- 4.3 Accessories used with SOLITEX EXTASANA which are supplied by the installer are:
- **Fixings** - staples, clouts, screws or proprietary sarking fixings, or other temporary fixings to attach the wall sarking to the framing.
 - **Wall sarking support** - polypropylene strap, 75 mm galvanised mesh, galvanised wire, or vertical cavity battens where required to support the sarking [refer to Paragraph 7.6].

Handling and Storage

- 5.1 Handling and storage of the product, whether on or off site, is under the control of the installer. The rolls must be protected from damage and weather. They must be stored on end, under cover, in clean, dry conditions and must not be crushed.

Technical Literature

- 6.1 Refer to the Appraisals listing on the BRANZ website for details of the current Technical Literature for SOLITEX EXTASANA. The Technical Literature must be read in conjunction with this Appraisal. All aspects of design, use, installation and maintenance contained in the Technical Literature and within the scope of this Appraisal must be followed.

Design Information

Timber and Steel Framing

- 7.1 Studs must be provided at maximum 600 mm centres. Nogging must be fitted flush between the studs at maximum 1200 mm centres.

General

- 7.2 SOLITEX EXTASANA is intended to be fixed over timber or steel framed walls in order to limit the entry of wind into building cavities, and to act as a secondary barrier to wind-driven rain.
- 7.3 The sarking also provides a degree of temporary weather protection during early construction. However, the sarking will not make the building weathertight and some wetting of the underlying structure is always possible before the building is closed in. Hence, the building must be closed-in and made weatherproof before moisture sensitive materials such as wall or ceiling linings and insulation materials are installed.
- 7.4 Refer to Table 1 for details of the material properties of SOLITEX EXTASANA and the relevant AS/NZS 4200.1 classifications.
- 7.5 SOLITEX EXTASANA is deemed to be a satisfactory sarking material for the waterproofing of walls in accordance with BCA Volume One, Paragraph F1.6.
- 7.6 In masonry veneer installations and wall cladding installations over a cavity, where the studs or cavity battens are installed at greater than 450 mm centres, the sarking must be supported to prevent the sarking bulging into the cavity space when bulk insulation is installed in the wall frame cavity.

Structure

- 8.1 SOLITEX EXTASANA is suitable for use on buildings situated in non-cyclonic wind zones up to, and including N3.

Table 1: SOLITEX EXTASANA Material Properties

AS/NZS 4200.1 Properties	Property Performance Requirement	Actual Property Performance	AS/NZS 4200.1 Classification
Resistance to dry delamination		Pass	Not Applicable
Resistance to wet delamination		Pass	Not Applicable
Shrinkage	≤ 0.5%	Pass	Not Applicable
Folding Endurance [machine direction]	≥ 2.00	Pass	Not Applicable
Folding Endurance [cross direction]	≥ 1.70	Pass	Not Applicable
Absorbency	≥ 100 g/m ²	Pass	High
Vapour Barrier	≤ 7 MN s/g	Pass	Low
Water Barrier	≥ 100 mm	Pass	High
Emittance			Non-reflective
Edge Tear and Tensile Strength		Edge tear: Machine direction [average] > 200 N Cross direction [average] > 150 N Tensile strength: Machine direction [average] > 4 kN/m Cross direction [average] > 2.9 kN/m	Extra Heavy Extra Heavy Unclassified Unclassified
Flammability	≤ 5	Pass	Low

Durability

Serviceable Life

9.1 Provided it is not exposed to the weather or ultra-violet light for a total of more than 90 days, and provided the exterior cladding is maintained in accordance with the cladding manufacturer's instructions and the cladding remains weather resistant, SOLITEX EXTASANA is expected to have a serviceable life equal to that of the cladding.

Flammability

10.1 SOLITEX EXTASANA has an AS 1530 Part 2 Flammability Index of less than 5 and therefore has a flammability index classification of low in accordance with AS/NZS 4200.1.

Heating Appliances, Fireplaces, Chimneys and Flues

11.1 SOLITEX EXTASANA must be separated from fireplaces, heating appliances, flues and chimneys in accordance with the requirements of the BCA for the protection of combustible materials.

Fire Resistance

Bush Fire Zones

- 12.1 Where regulations require special attention in bushfire prone areas, it may be necessary for SOLITEX EXTASANA sarking to comply with AS 3959. The building designer is responsible for determining the compliance requirements.

Damp and Weatherproofing

- 13.1 Wall claddings installed over SOLITEX EXTASANA must meet the performance requirements of the BCA, e.g. Deemed to Satisfy wall claddings covered by the BCA, or wall claddings covered by a valid BRANZ Appraisal.
- 13.2 SOLITEX EXTASANA, when installed in accordance with the Technical Literature and this Appraisal will assist in the total cladding systems compliance with the Damp and Weatherproofing performance clauses of the BCA.

Installation Information

Installation Skill Level Requirements

- 14.1 Installation must always be carried out in accordance with the SOLITEX EXTASANA Technical Literature and this Appraisal, by competent tradespersons with an understanding of wall sarking installation.

Sarking Installation

- 15.1 SOLITEX EXTASANA must be fixed to all framing members at maximum 300 mm centres with large-head clouts 20 mm long, 6-8 mm staples, self drilling screws or proprietary sarking fixings. The sarking must be pulled taut over the framing before fixing.
- 15.2 SOLITEX EXTASANA must be run horizontally and must extend from the upper-side of the top plate to the under-side of the bearers or wall plates supporting ground floor joists, or below bottom plates on concrete slabs. Horizontal laps must be no less than 150 mm wide, with the direction of the lap ensuring that water is shed to the outer face of the membrane. End laps must be made over framing and be no less than 150 mm wide.
- 15.3 The wall sarking should be run over openings and these left covered until windows and doors are ready to be installed. Openings are formed in the sarking by cutting on a 45 degree diagonal from each corner of the penetration. The flaps of the cut sarking must be folded inside the opening and stapled to the penetration framing. Excess sarking may be cut off flush with the internal face of the wall frame.
- 15.4 Where the sarking needs to be supported, polypropylene strap or galvanised wire must be installed horizontally over the sarking at 300 mm centres. Alternatively, 75 mm galvanised wire mesh can be installed over the entire sarking surface.
- 15.5 SOLITEX EXTASANA can be added as a second layer over window and door joinery head flashings.
- 15.6 When used behind masonry veneer cladding, the brick ties must be fixed to the face of the stud only.
- 15.7 When fixing the product in windy conditions, care must be taken due to the large sail area created by wide roll widths.
- 15.8 Any damaged areas of SOLITEX EXTASANA, such as tears, holes or gaps around service penetrations, must be repaired. Damaged areas can be repaired by covering with new material lapping the damaged area by at least 150 mm and taping, or by taping small tears.

Inspections

- 15.9 The Technical Literature must be referred to during the inspection of SOLITEX EXTASANA installations.

Basis of Appraisal

The following is a summary of the technical investigations carried out:

Tests

- 16.1 The following tests have been carried out on SOLITEX EXTASANA in accordance with AS/NZS 4200.1: Resistance to dry delamination, resistance to wet delamination, shrinkage, folding endurance, tensile strength, edge-tear resistance, resistance to water vapour transmission, resistance to water penetration, and surface water absorbency. A range of these tests were completed before and after SOLITEX EXTASANA was exposed to ultra-violet light.
- 16.2 The Flammability Index of SOLITEX EXTASANA has been evaluated in accordance with AS 1530.2.

Other Investigations

- 17.1 A durability opinion has been given by BRANZ technical experts.
- 17.2 The practicability of installation of SOLITEX EXTASANA has been assessed by BRANZ and found to be satisfactory.
- 17.3 The Technical Literature, including installation instructions, has been examined by BRANZ and found to be satisfactory.

Quality

- 18.1 The manufacture of SOLITEX EXTASANA SOLITEX EXTASANA has been examined on behalf of BRANZ, including methods adopted for quality control. Details of the quality and composition of the materials used have been obtained and found to be satisfactory.
- 18.2 The quality of supply to the market is the responsibility of Pro Clima Australia Pty Ltd.
- 18.3 Building designers are responsible for the design of the building, and for the incorporation of the wall sarking into their design in accordance with the instructions of Pro Clima Australia Pty Ltd.
- 18.4 Quality of installation is the responsibility of the installer in accordance with the instructions of Pro Clima Australia Pty Ltd.

Sources of Information

- AS 1530.2: 1993 Test for flammability of materials.
- AS 3959: 2009 Construction of buildings in bushfire-prone areas.
- AS/NZS 4200.1: 1994 Pliable building membranes and sarkings - materials.
- National Construction Code Series, Building Code of Australia 2013, Australian Building Codes Board.

Amendments

Amendment No. 1, dated 06 May 2014

This Appraisal has been amended to update the maximum exposure period for SOLITEX EXTASANA from 42 days to 90 days.



In the opinion of BRANZ, **SOLITEX EXTASANA Wall Protection Membrane** is fit for purpose and will comply with the Building Code to the extent specified in this Appraisal provided it is used, designed, installed and maintained as set out in this Appraisal.

The Appraisal is issued only to **Pro Clima Australia Pty Ltd**, and is valid until further notice, subject to the Conditions of Appraisal.

Conditions of Appraisal

1. This Appraisal:
 - a) relates only to the product as described herein;
 - b) must be read, considered and used in full together with the Technical Literature;
 - c) does not address any Legislation, Regulations, Codes or Standards, not specifically named herein;
 - d) is copyright of BRANZ.
2. **Pro Clima Australia Pty Ltd:**
 - a) continues to have the product reviewed by BRANZ;
 - b) shall notify BRANZ of any changes in product specification or quality assurance measures prior to the product being marketed;
 - c) abides by the BRANZ Appraisals Services Terms and Conditions.
 - d) Warrants that the product and the manufacturing process for the product are maintained at or above the standards, levels and quality assessed and found satisfactory by BRANZ pursuant to BRANZ's Appraisal of the product.
3. BRANZ makes no representation or warranty as to:
 - a) the nature of individual examples of, batches of, or individual installations of the product, including methods and workmanship;
 - b) the presence or absence of any patent or similar rights subsisting in the product or any other product;
 - c) any guarantee or warranty offered by **Pro Clima Australia Pty Ltd**.
4. Any reference in this Appraisal to any other publication shall be read as a reference to the version of the publication specified in this Appraisal.
5. BRANZ provides no certification, guarantee, indemnity or warranty, to **Pro Clima Australia Pty Ltd** or any third party.

For BRANZ



Chris Preston

Chief Executive

Date of Issue:

15 July 2013