



A1131-4 Pro Clima Skillion Eave on SIP Wall - Vented Fascia



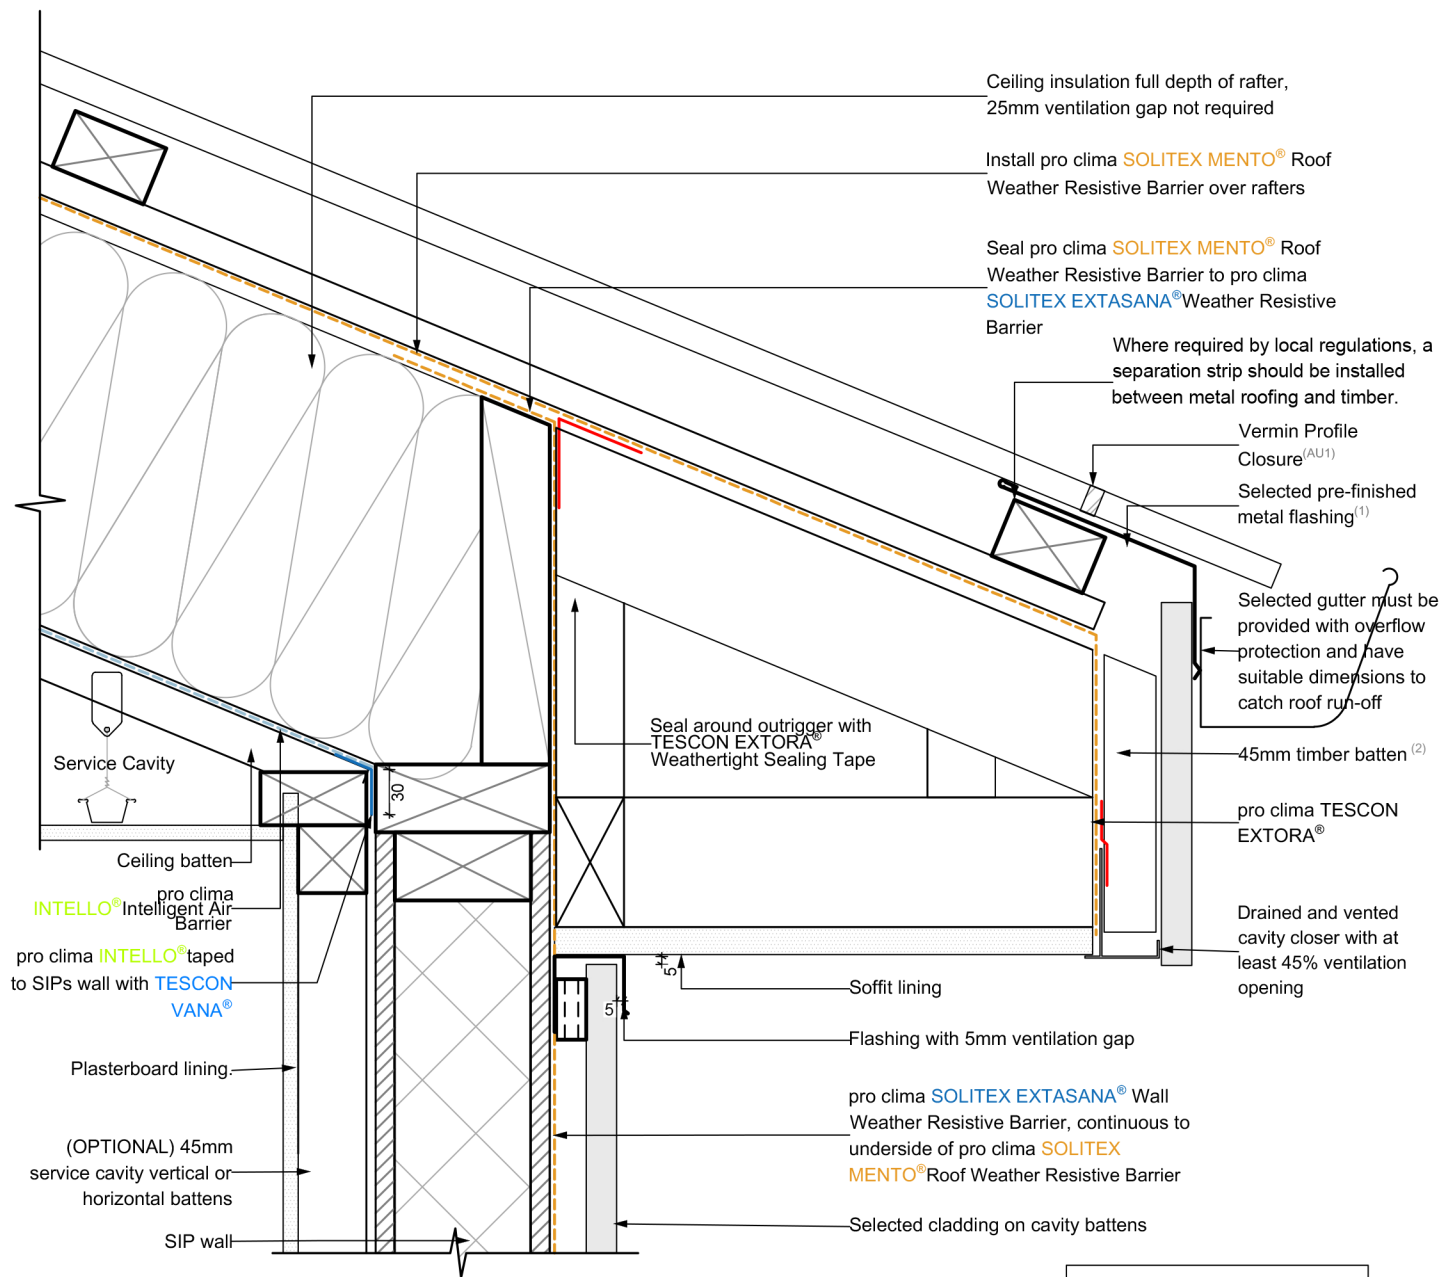

NOTE: Minimum 10° Pitch without rigid sheathing board

NOTES:

1: Additional ventilation can be achieved to increase the purge rate of heat in summer by utilising a perforated flashing at the eave.

2: Normal Ventilation: Timber packer should be 45mm in combination with at least 45% open area cavity closer.

Strong Ventilation: Timber packer should be 90mm in combination with at least 45% open area cavity closer.

The depth of the cavity can be reduced for cavity closers with higher open area ratios.

$$\text{Ventilation} = (\text{Packer}) \times (\text{Open Area Ratio})$$

$$\text{Normal Ventilation} \geq 200\text{cm}^2/\text{m}$$

$$\text{Strong Ventilation} \geq 400\text{cm}^2/\text{m}$$

AUSTRALIA ONLY:

1: Vents/Cavity closers must meet AS 3959 requirements for bushfire protection up to BAL 40. This can be achieved by fitting an ember guard made of non-combustible material or a mesh or perforated sheet with ≤ 2 mm holes and made of corrosion-resistant steel or bronze.



Title: Skillion Eave on SIP Wall - Vented Fascia

ID: A1131-4

Issued: 01/07/2021

Revision: E

© This drawing is the property of Pro Clima NZ Ltd &/or Pro Clima Australia Pty Ltd and must not be copied without permission. This drawing is a guideline only and subject to change without notice. Thermal and hygrothermal performance should match specific design, materials and climate requirements. These can be confirmed by hygrothermal analysis using software e.g. WUFI®. Structural, fire and acoustic engineering design and the incorporation of building services (plumbing and electrical) should be signed-off by a suitably qualified engineer to ensure compliance with all health and safety requirements.